

NFF-642P

LCD RELEASE CONTROL PANEL

NFF-642P TWO AREA FIRE RELEASE CONTROL PANEL

PRODUCT OVERVIEW




NFF-642P Gas fire extinguishing controller for use in gas automatic fire extinguishing system. The gas fire extinguishing controller can connect to all types of conventional detectors, abort switch, automatic transfer switch, visible and audible alarm devices and electromagnetic valve which used to start the gas fire extinguishing equipment.

NEVERFIRE panels has been designed to EN54 part 2 and EN54 part 4 and have all the safety features to prevent accident release.

NFF-642P certified CE QACE20241069 ⁽¹⁾ which play a vital role in ensuring that NEVERFIRE products placed on the market of the world are safe. And certified ISO9001:2015⁽¹⁾ Quality management systems and requirements, which is global standard for trusted goods and services.

DESCRIPTION

NFF-642P panel is Microprocessor based Conventional fire agent release Control Panel which has two detection circuits and one agent release circuit ,These control panel designed for small to medium commercial,residential, multi-family,institutional and industrial occupancies. NEVERFIRE Conventional Agent Release Control Panels are a feature packed control unit performing dual function of detection and controlled release of gaseous agent. NEVERFIRE Agent Release Control Panels easy to install, commission and is the first choice for protection from fire. They are Compatible with conventional detectors, manual call points and normally open dry contact devices.

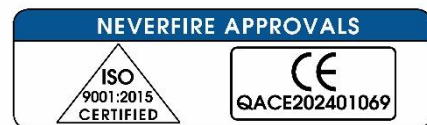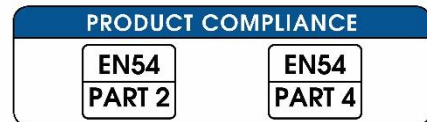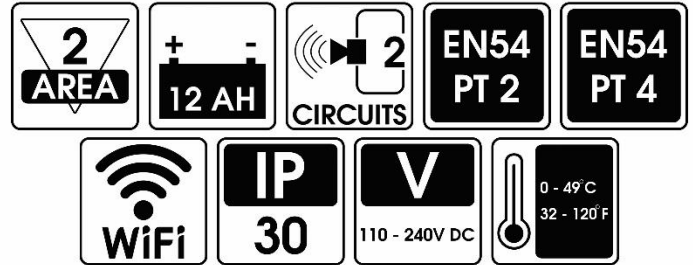

(1) you can view & download these certificates from ASSS website www.asss-eg.com

©2025 ASSS com., The company reserves the right to change the specifications of the products at any time and without prior notice. All information in this documents is given in good faith but ASSS com. Cannot be held Responsible for any omissions or errors. Printed in Egypt.



NFF-642P

LCD RELEASE CONTROL PANEL

STANDARD FEATURES

√ 2 class B Releasing Agent Circuits (RAC).	√ 2 Class B notification appliance circuits (NAC).
√ Zone Disable (isolation).	√ Four class B initiating Circuits.
√ Programmable two input circuits for Manual release and Abort switch.	√ Configurable first stage NAC delays.
√ Form C relays for fire and fault.	√ 16x2 dot matrix LCD display.
√ Access via password – removes problem of lost keys.	√ Lamp test facility.
√ Evacuate and Key pad Enable, Display Facility.	√ Earth fault annunciation facility at 0 ohms.
√ Two mode operation facility(Auto\ Manual)	√ Relay output for actuators.
√ Low Battery visual warning with audible tone.	√ Manual Gas Release with or without Timer.
√ Programmable RAC's with count down timer.	√ Programmable 24VDC Output.
√ Fully programmable using simple menu options.	√ RS 485 communication facility for Repeater (Optional).
√ All fields wiring circuits are power limited except 120 \ 240 AC and Battery.	√ All field wiring circuits are supervised.
√ Operates on 100-240VAC, 50\60Hz, AC mains 2A Din Rail power supply.	√ Standby (Battery) backup 24VDC power supply with built in charger (Charging Current 0.5Amps max).
√ System Voltage 24V DC (Nominal) 5A	√ Charging Voltage 28VDC,±2%.
√ Standby Current 6.8mA (2.4mA for Detectors).	√ Maximum battery size 12Ah.
√ Auto Resetttable Fuse.	√ Battery polarity reversible protection.
√ Over All current consumption is low.	√ All zones Compatible with all types of conventional detectors and any normally open contact device.

MOUNTING DETAILS

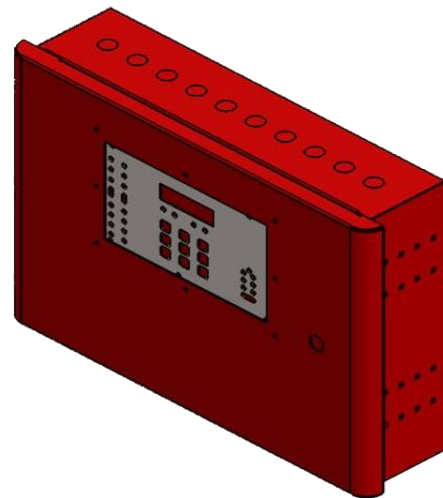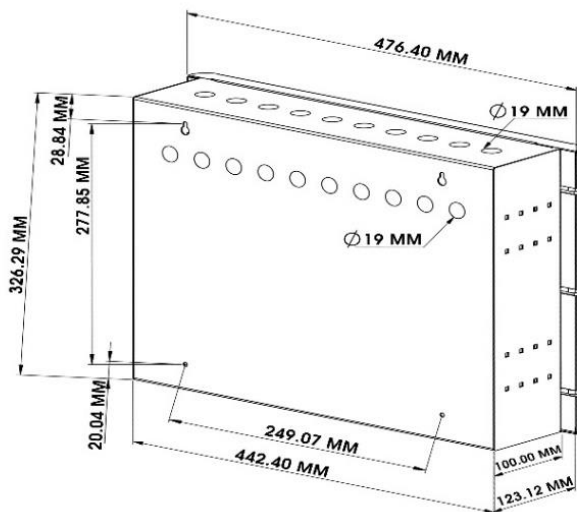

©2025 ASSS com., The company reserves the right to change the specifications of the products at any time and without prior notice. All information in this documents is given in good faith but ASSS com. Cannot be held Responsible for any omissions or errors. Printed in Egypt.

Issue: 001

Date: 2025/01/08

Page: 2 of 3

AL ALAMIA FOR SAFETY & SECURITY SYSTEMS COM. (ASSS)

Factory: 16C, south industrial Zone, 10th of Ramadan City, Sharkyia, Egypt.

Administration: No.6, 163 St, Behind the military hospital, El Maadi, Cairo, Egypt.

TEL.: +2 02 25249113 **FAX.:** +2 02 25281778

MOBILE: +2 01129277269

E-Mail: info@asss-eg.com

WWW.ASSS-EG.COM

ASSS FACTORY is the first manufacture for fire alarm system in Africa & middle east.

The com. established since 2011 located in cairo governorate while the factory located in Sharkyia governorate.

NFF-642P

LCD RELEASE CONTROL PANEL

TECHNICAL SPECIFICATIONS	
ELECTRICAL SPECIFICATIONS	
MODEL NUMBER	NFF-642P
Supply Voltage	100-240VAC± 10%, 50Hz
AC Supply Fuse	5 Amp 250V 20mm
System Voltage	24V DC (Nominal).
Solenoid Output	0.8A for each Circuit.
Zone Voltage	21V DC (Nominal).
Zones EOL Resistor	3.9k 5%, 1\4 watt.
NAC EOL Resistor	3.9K 5%, 1\4 watt.
Fault Relay	1 x Volt Free Relay, SELV@ 1A Max.
Fire Relay	1 x Volt Free Relay,SELV @1A Max.
Battery cut off	Battery voltage less than 20V
Maximum battery Space	2 x 12 Ah, 12 Vdc sealed lead acid.
NAC Rating	0.5A per Circuit 1A Total.
Detection Zone Current	1.6mA
Communication	WiFi (Option)
Cable Capacity	14 AWG
OPERATING CONDITION	
Operating Temperature	0 - 49°C \ 32 - 120°F
Storage Temperature	0°C - 60°C
Relative Humidity	93 ± 2% RH (non-condensing) at 32±2°C \ 90±3°F
MECHANICAL SPECIFICATIONS	
Cable Entry	10xø19mm Knockout on top of the cabinet. 10xø19mm Knockout on backside of the cabinet.
Ingress Protection Rating	IP30
Dimensions	476.40W x 326.29H x 123.12D mm.
Construction	1.22 mm Cold-Rolled Steel grade 37 (ST37).
color	Red Ral 3020.
weight	7Kg (Excluding Batteries).
Carton Dimensions	520*365*160 mm.

WARRANTY

NEVERFIRE warrants that product from defects in design, materials and workmanship during the warranty period ensuring customers' confidence in product quality and performance.

For comprehensive information, including installation guidelines and compatibility details, please consult NEVERFIRE Installation Manual or reach out to our technical support team. Anybody, including the agents, distributors or employees, is not in the position to amend the contents of this warranty.

©2025 ASSS com., The company reserves the right to change the specifications of the products at any time and without prior notice.

All information in this documents is given in good faith but ASSS com. Cannot be held Responsible for any omissions or errors. Printed in Egypt.

Issue: 001

Date: 2025/01/08

Page: 3 of 3

AL ALAMIA FOR SAFETY & SECURITY SYSTEMS COM. (ASSS)

Factory: 16C, south industrial Zone, 10th of Ramadan City, Sharkyia, Egypt.

Administration: No.6, 163 St, Behind the military hospital, El Maadi, Cairo, Egypt.

TEL.: +2 02 25249113 **FAX.:** +2 02 25281778

MOBILE: +2 01129277269

E-Mail: info@asss-eg.com

WWW.ASSS-EG.COM

ASSS FACTORY is the first manufacture for fire alarm system in Africa & middle east.

The com. established since 2011 located in cairo governorate while the factory located in Sharkyia governorate.